


SolShare Fused Isolator SLD

Example Diagram

Note: This design DOES NOT SUPPORT BATTERY integrations. Contact Allume when designing any battery project.

Typical install Locations:

Energy meters in risers
Co-located energy meters

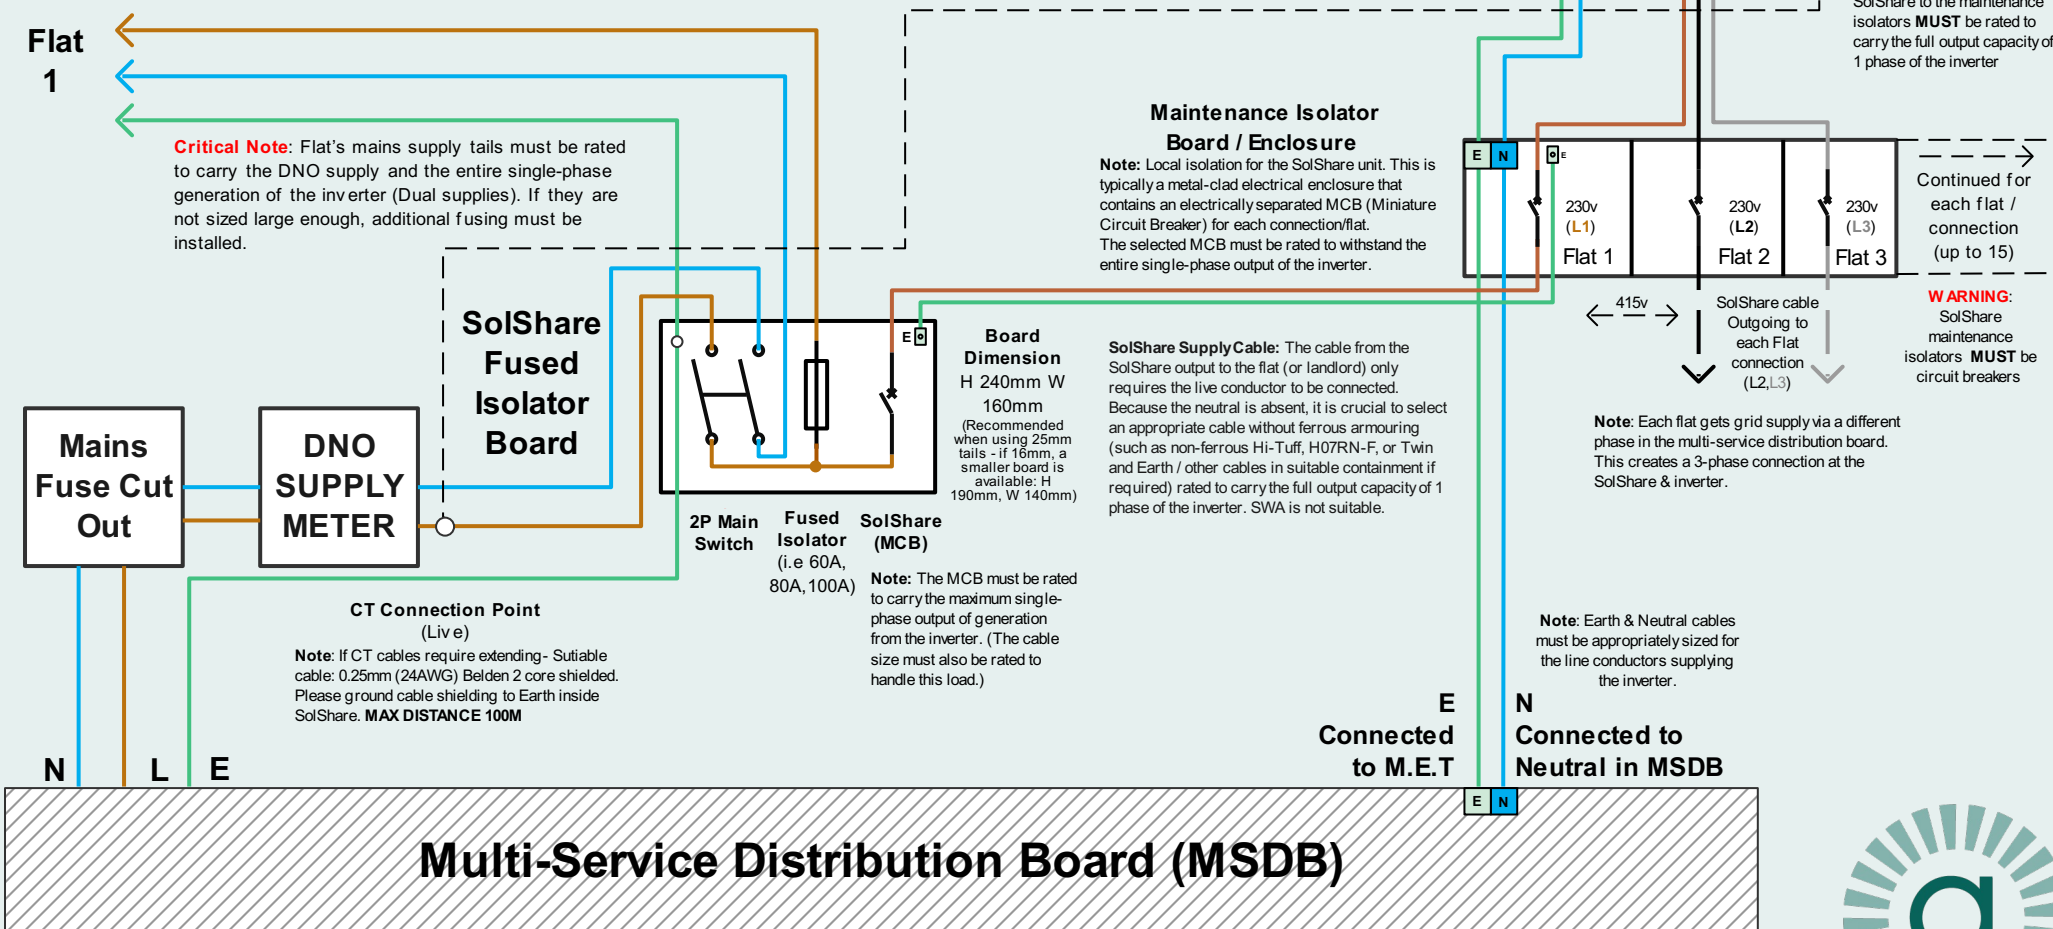

GUIDANCE ONLY – Installation must fully conform to BS7671 Wiring Regulations. Refer to **site-specific** schematics for final installation details.

Note: This diagram applies to **SolShare 2 only**. Click here for SolShare 1 SLD

