


Consumer Unit Connection SLD

Example Diagram

Note: This design DOES NOT SUPPORT BATTERY integrations. Contact Allume when designing any battery project.

Typical install location:
Energy Meter in Flat

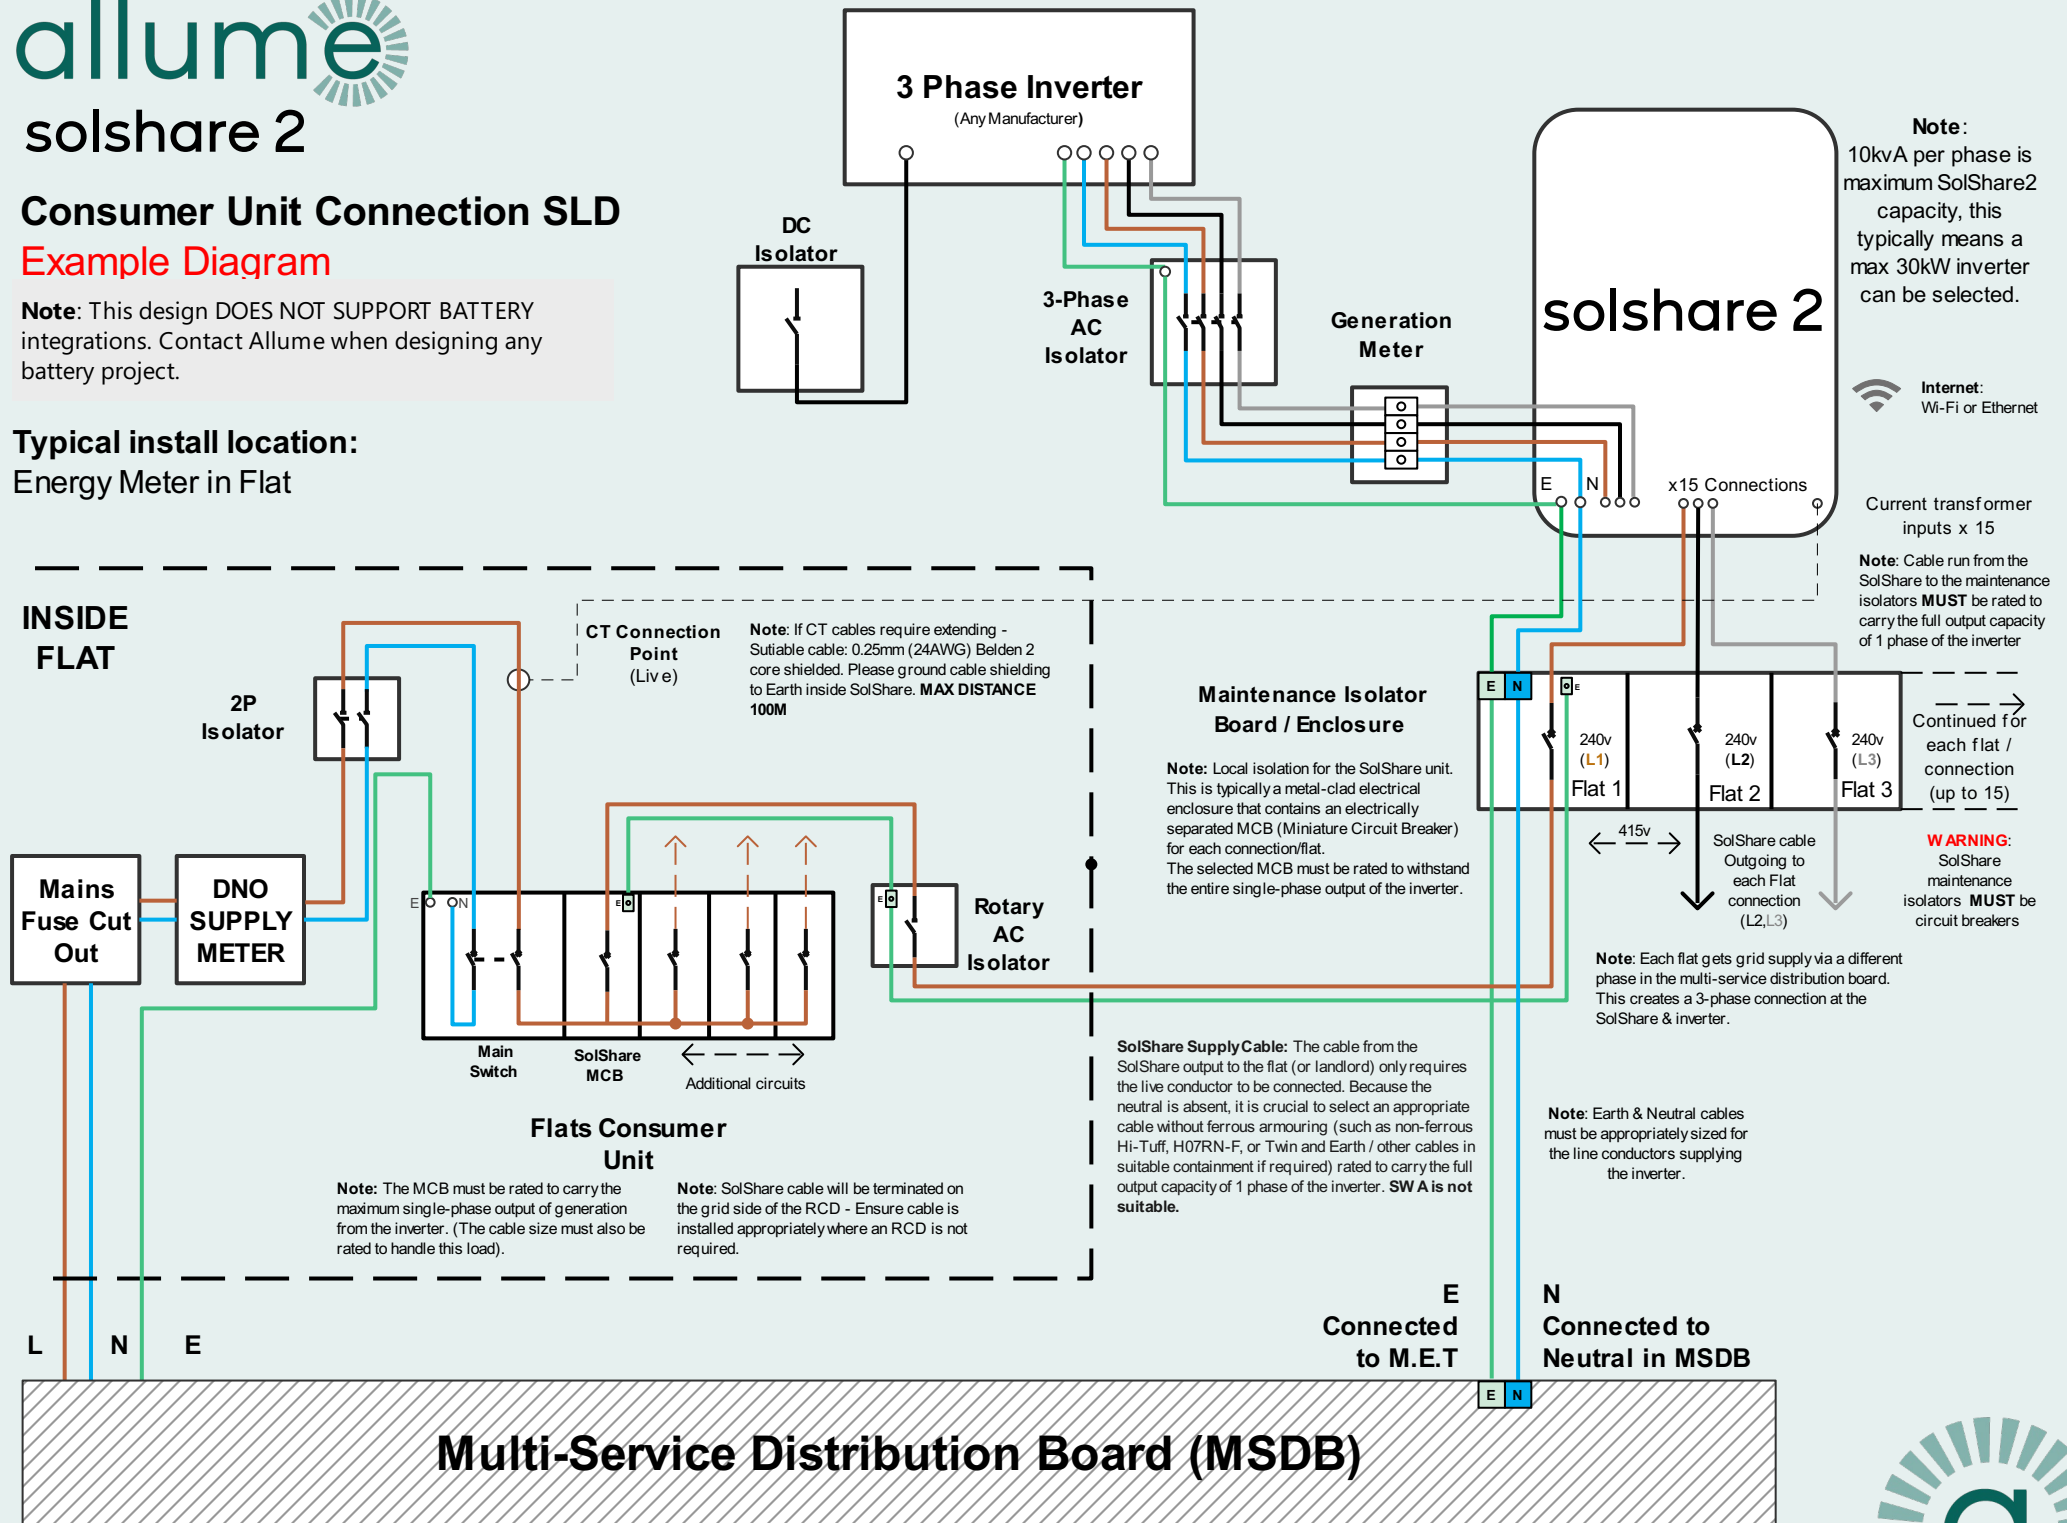

GUIDANCE ONLY – Installation must fully conform to BS7671 Wiring Regulations. Refer to **site-specific** schematics for final installation details.

Note: This diagram applies to **SolShare 2 only**. Click here for SolShare 1 SLD

