




solshare 2

3-Pole Isolator SLD

Example Diagram

Note: This design DOES NOT SUPPORT BATTERY integrations. Contact Allume when designing any battery project.

Typical install location: Energy Meters co-located

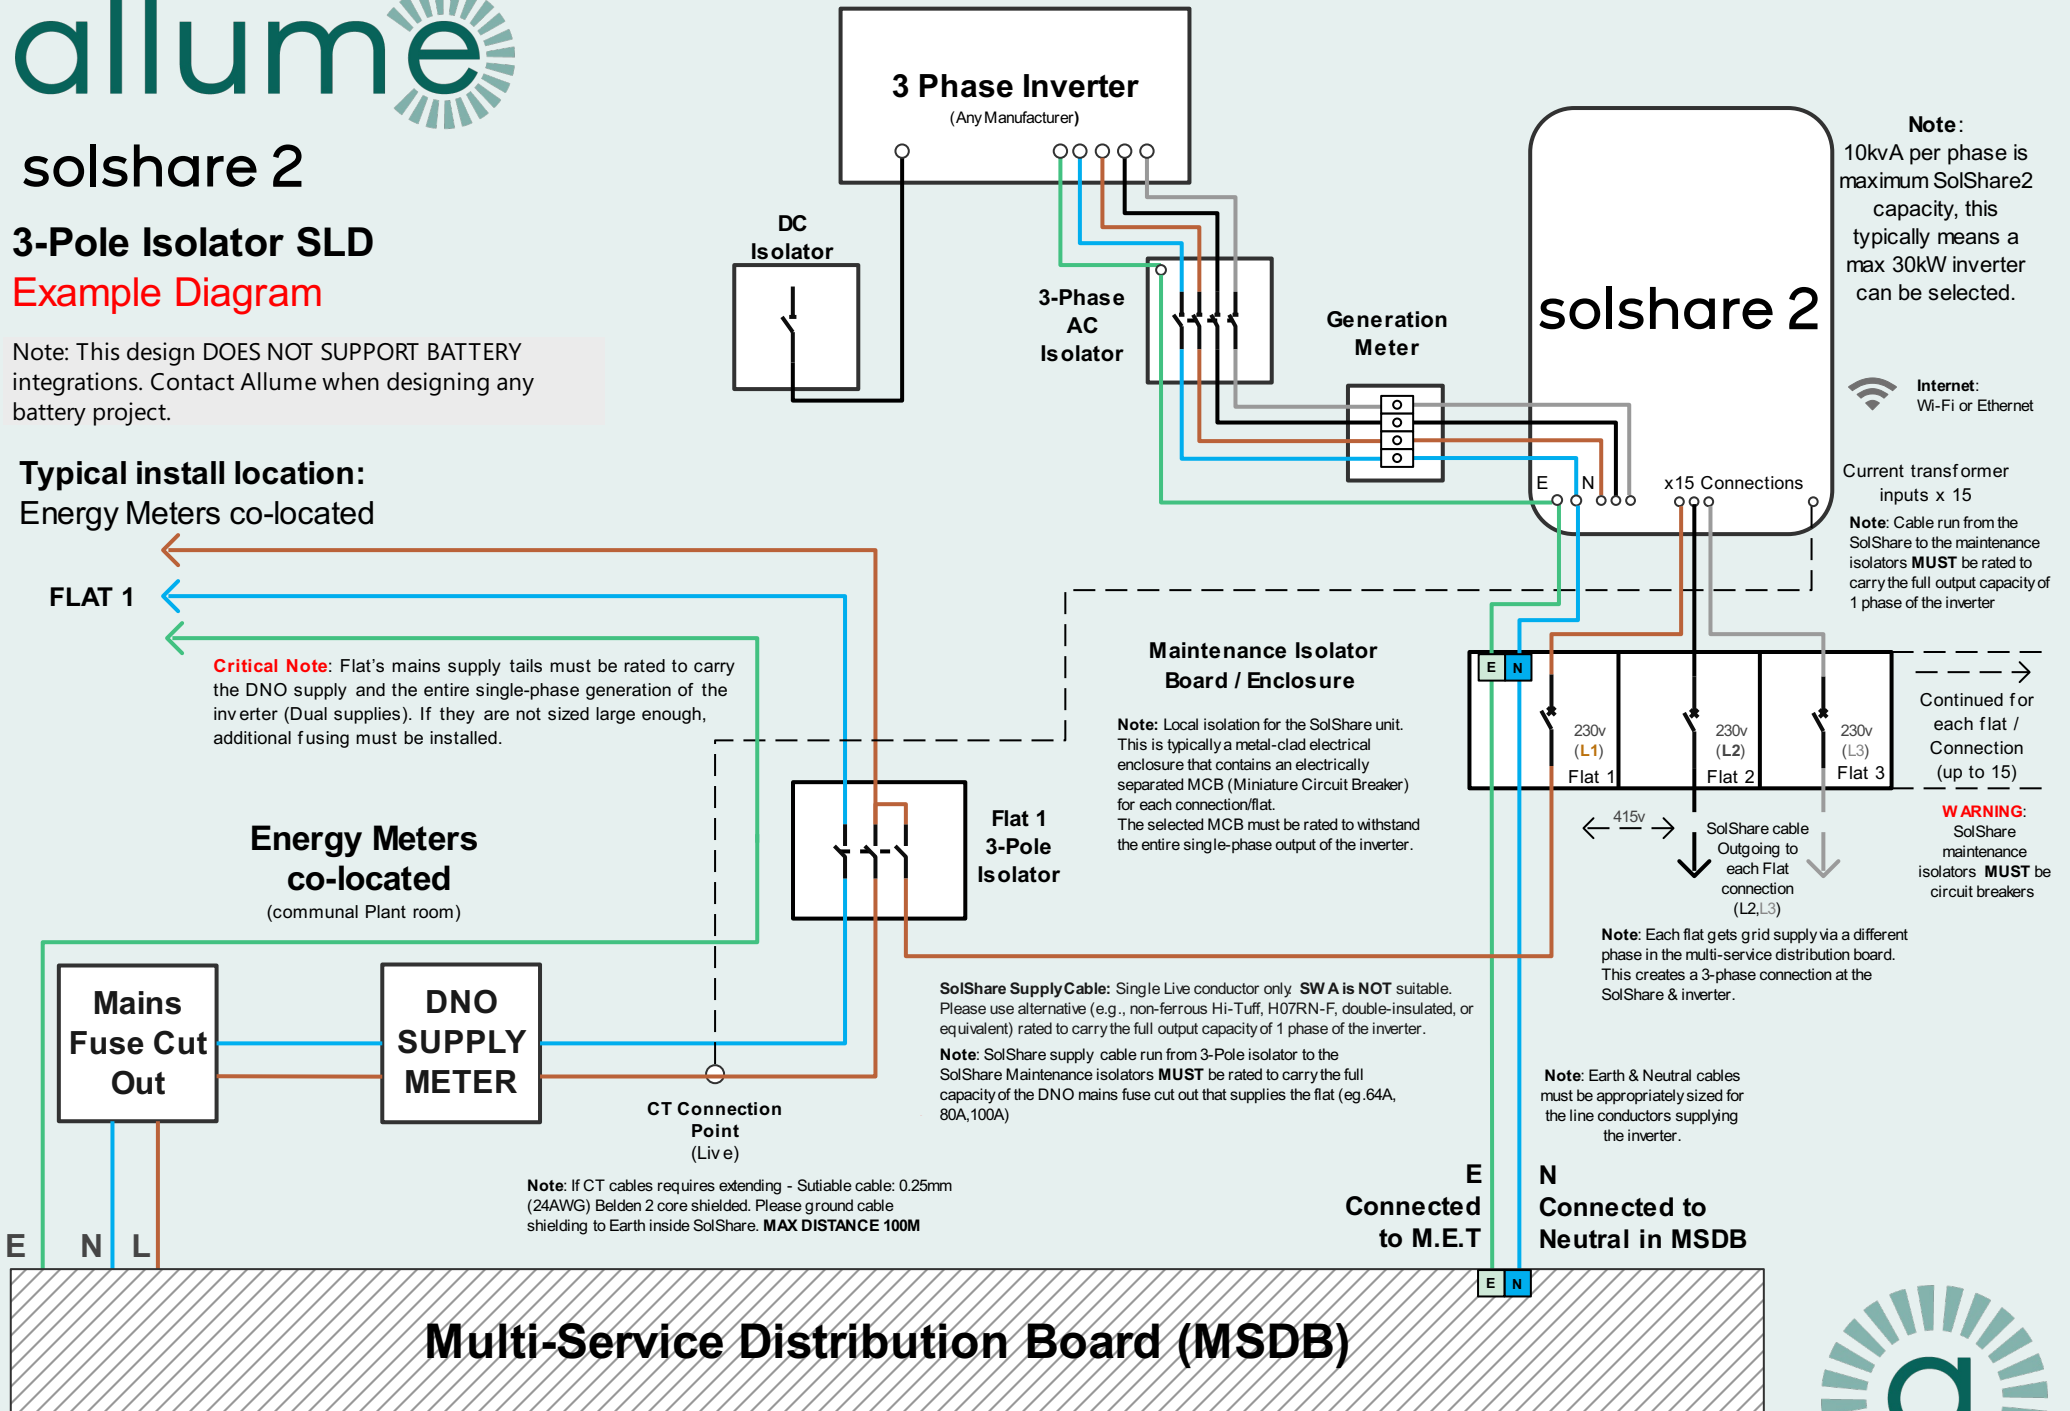

GUIDANCE ONLY – Installation must fully conform to BS7671 Wiring Regulations. Refer to **site-specific** schematics for final installation details.

Note: This diagram applies to **SolShare 2** only. [Click here for SolShare 1 SLD](#)

